



## ANNUAL SUMMARY REPORT

### THE CORPORATION OF THE TOWN OF COBOURG

#### *COBOURG DRINKING WATER SYSTEM*

Prepared by Lakefront Utility Services Inc. (2020)

## CONTENTS

<b>1.</b>	<b>PURPOSE .....</b>	<b>3</b>
<b>2.</b>	<b>COBOURG DRINKING WATER SYSTEM OVERVIEW .....</b>	<b>4</b>
<b>3.</b>	<b>2019 COMPLIANCE .....</b>	<b>4</b>
3.1	MECP Inspection .....	4
3.2	License & Permit Compliance .....	4
3.3	Adverse Water Quality Incident(s).....	7
<b>4.</b>	<b>CONTINUAL IMPROVEMENT .....</b>	<b>7</b>
<b>5.</b>	<b>SAMPLING AND ANALYSIS .....</b>	<b>7</b>

## 1. PURPOSE

The purpose of the Annual Water Quality Report is to provide information to residents and stakeholders of the Town of Cobourg. Furthermore, satisfying the regulatory requirements of the *Safe Drinking Water Act, 2002* including the Drinking Water Quality Management Standard (DWQMS) reports to owner, and regulatory reporting required under *Ontario Regulation 170/03*. This annual water quality report fulfills all requirements of *Ontario Regulation 170/03* Section 11 Annual Reports and Schedule 22 Summary Reports for Municipalities.

The annual water quality report is prepared by Lakefront Utility Services Inc. (operating authority) on behalf of The Town of Cobourg (owner).

### Scope

This annual water quality report includes information pertaining to the Town of Cobourg's Drinking Water System (Cobourg DWS) for the period of January 1, 2019 to December 31, 2019. *Ontario Regulation 170/03* requires reported information be provided to:

- **Drinking Water System Owners (Mayor and Council)**
- **Owner and Operating Authority Top Management**
- **The Public**

### Availability

The Cobourg DWS is a large municipal residential system that serves more than 10,000 people. Copies of this annual water quality report are available online at <https://www.lakefrontutilities.com/regulatory-water/>. Hard copies are also available at the LUSI's office at 207 Division St, Cobourg ON, K9A 4L3.

Customers of the Cobourg DWS are notified that the annual water quality report is available via "What's New" <https://www.lakefrontutilities.com/whats-new/>, social media posts and "Stay Connected" LUSI bill insert.

### Council Resolution

*Ontario Regulation 170/03* requires Summary Reports be distributed to municipal council no later than March 31 of each year. The Town of Cobourg must provide LUSI with a copy of council resolution indicating the report has been accepted.

## 2. COBOURG DRINKING WATER SYSTEM OVERVIEW

The Cobourg Water Treatment Plant (WTP) takes water from Lake Ontario through an 860m-long intake pipe. Raw water is pre-chlorinated for zebra-muscle control before it enters a full conventional treatment process. The treatment process includes coagulation, flocculation, sedimentation, and filtration. **Aluminum sulphate** is used as the coagulation agent, with an addition of **Flowpam AN 934 PWG** (polymer) to aid in the process. Primary disinfection is achieved with **gaseous chlorine** after water undergoes an appropriate contact time, after which the water is stored in a 6240m<sup>3</sup> in-ground reservoir, from where it is then pumped to the distribution system.

The distribution system consists of two pressure zones, with an elevated water storage tank in each of the zones. The Water Treatment Plant supplies water to the zone 1 tower, with a holding capacity of 1332m<sup>3</sup>. The booster station, located at the boundary of the two zones, supplies water to the zone 2 tower, with a holding capacity of 3734m<sup>3</sup>. Zone 1 tower, zone 2 tower and the booster station are all equipped with **sodium hypochlorite** and rechlorination equipment to maintain proper disinfection.

Water from the Cobourg DWS is conveyed to Hamilton Township, as an extension of the Cobourg DWS, agreed upon in writing.

## 3. 2019 COMPLIANCE

### 3.1 MECP INSPECTION

The MECP began an unannounced detailed inspection of the Cobourg DWS on August 20, 2019. A final inspection rating of 100% was achieved. There were no non-compliances with regulatory requirements, and no identified recommendations or issues related to best practices.


### 3.2 LICENSE & PERMIT COMPLIANCE


The Cobourg DWS maintained compliance with all applicable legislation, and all terms and conditions of the Municipal Drinking Water License, Drinking Water Works Permit and Permit to Take Water in 2019.

The Cobourg DWS Permit to Take Water (Permit No. 6423-8X8HF2) allows the taking of 31,822 m<sup>3</sup> of water from Lake Ontario per day at a rate of 31,177L/min. The average flow rate from Lake Ontario was 6,000L/min, below the maximum rate.

The total quantity of water taken and discharged from the WTP is illustrated in Figure 1. In 2019 there were no incidents related to surpassing the maximum volume of water permitted to take. In July 2019, the WTP operated at 29% of its maximum rated capacity, as shown in Figure 2. The labels presented in Figure 2 are representative of the maximum flow observed for the respective month (m<sup>3</sup>).

Figure 1 - Flow Quantities for the Cobourg Drinking Water System

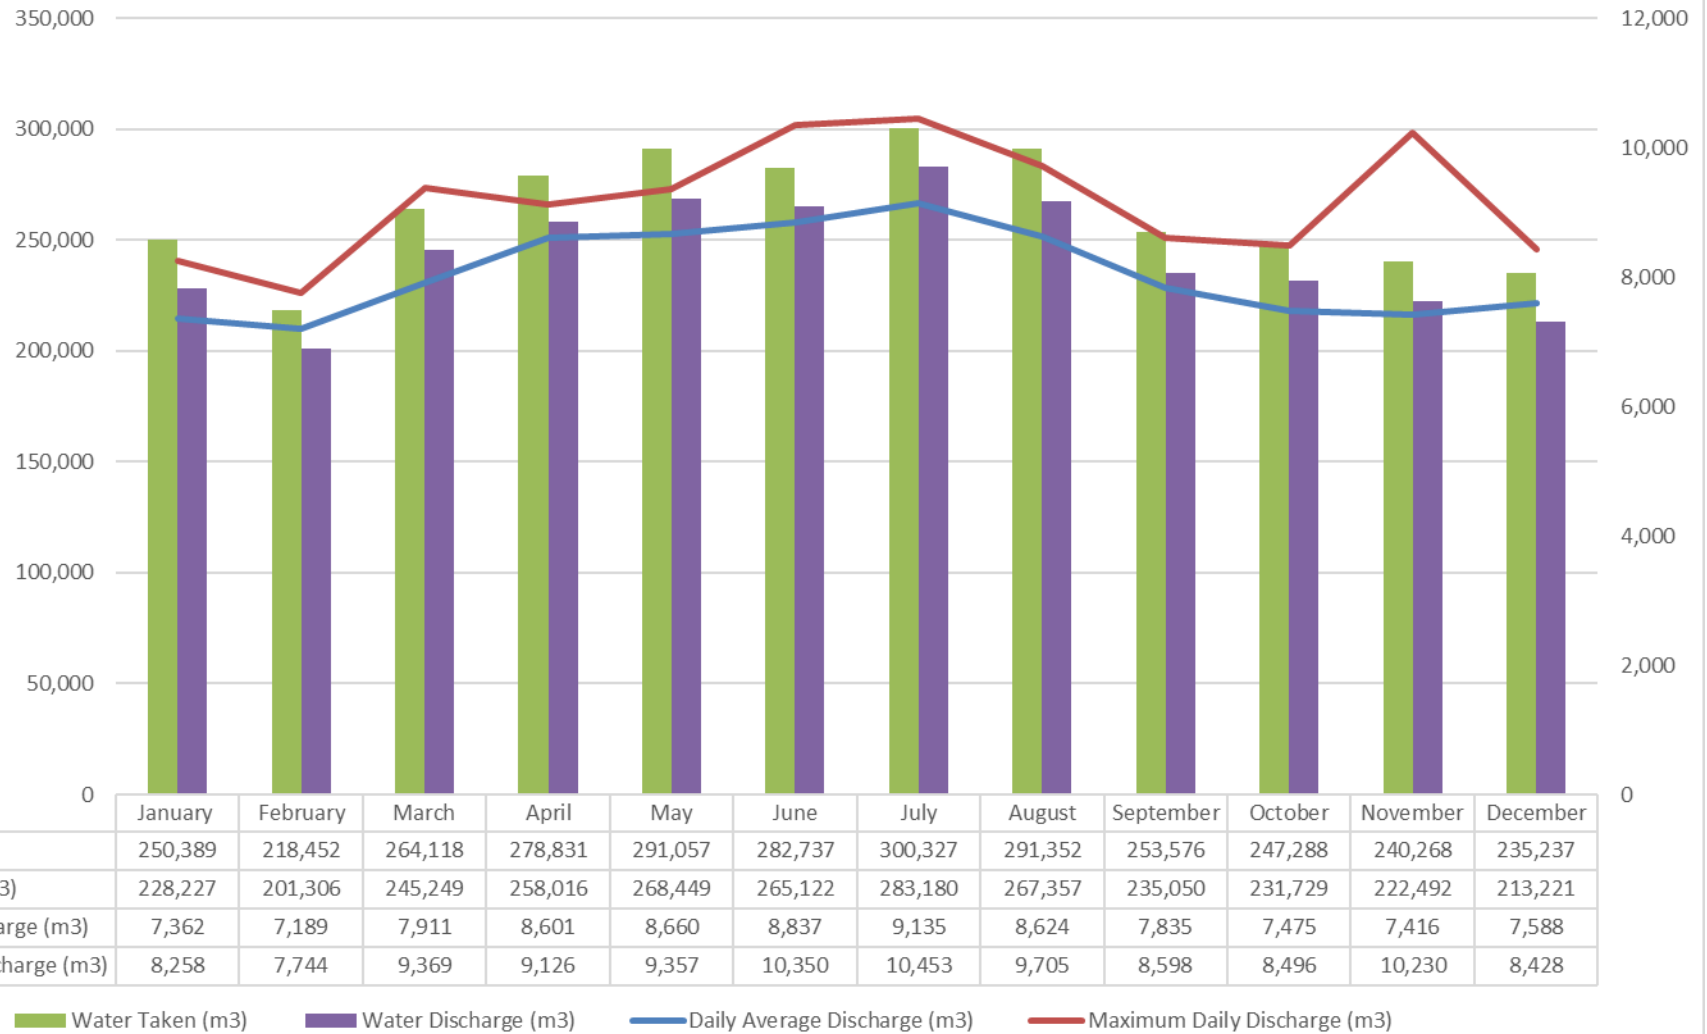

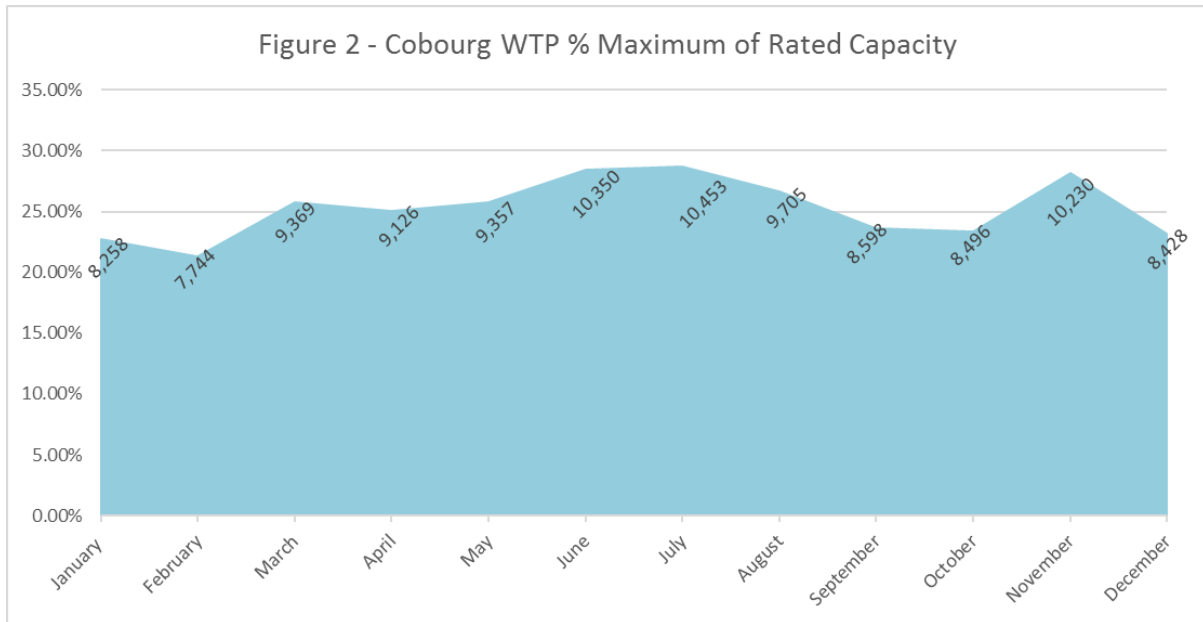

### 3.3 ADVERSE WATER QUALITY INCIDENT(S)

#### Incident #1 – April 11, 2019

During a routine watermain break repair at 700 D’Arcy St insufficient water pressure was maintained to ensure positive pressure. The Public Health Unit issued a boil water advisory for 700 D’Arcy St (buildings 18 and 19) on April 11, 2019. Upon completion of the repair the watermain was directionally flushed and two consecutive bacti samples, including HPC, were taken. Laboratory results indicating no presence of E. Coli or total coliform were obtained on April 15, 2019. The Public Health Unit rescinded the boil water advisory on April 15, 2019.

## 4. CONTINUAL IMPROVEMENT

LUSI’s commitment to continual improvement requires investigating and investing in, where appropriate, methods and technologies to improve

- The quality of processes used to ensure production of ample clean water, and
- The quality and effectiveness of the distribution system.

During the 2019 reporting year, LUSI demonstrated this commitment by completing all the activities listed in Table 1. Table 1 also satisfies O. Reg 170/03 requirement to describe major expenses occurred during the reporting period.

<b>Cobourg Water Treatment Plant</b>	Pump House and Chemical Feed Building Heating System Upgrade	\$240,000
	WTP Rooftop Solar Project	\$222,000
	Filter Gallery Mold Rehabilitation	\$203,000
	Clarifier Bolt Replacement	\$50,000
	Level Sensor Replacement	\$10,000
<b>Cobourg Distribution System</b>	Tower #2 Refurbishment	\$2,422,000
	Trench Box	\$14,400
	RF Water Meter Replacement	\$132,000
	Watermain Design	\$50,000
<b>Miscellaneous</b>	IT Hardware and Software	\$68,800

## 5. SAMPLING AND ANALYSIS

The Cobourg DWS exhibited compliance with all sampling and testing as required by *Ontario Regulation 170/03* in the 2019 calendar year. Table 2 illustrates all microbiological testing done under Schedule 10 of *Ontario Regulation 170/03*. There were no instances of adverse water quality results as a result of a parameter exceeding its respective maximum acceptable concentration.

	<b>E. Coli, (cfu/100mL)</b>		<b>Total Coliform, (cfu/100mL)</b>		<b>HPC, (cfu/1mL)</b>	
	# of Samples	Range of Results (min # - max #)	# of Samples	Range of Results (min # - max #)	# of Samples	Range of Results (min # - max #)
<b>Raw</b>	54	0 - 7	54	0 - 360	0	N/A
<b>Treated</b>	54	0 - 0	54	0 - 0	54	0 - 1
<b>Distribution</b>	392	0 - 0	392	0 - 0	227	0 - 116

Note: Table 2 contains microbiological sampling taken within the Hamilton Township Stand-alone Distribution System.

Operational testing done under Schedule 7 of Ontario Regulation 170/03 during the 2019 reporting period are tabulated in Table 3.

	Number of Grab Samples	Range of Results (min # - max #)
<b>Filter Turbidity (NTU)</b>	8760 (continuous monitoring)	0.01 – 0.57
<b>Contact Chamber Effluent Free Chlorine Residual (mg/L)</b>	8760 (continuous monitoring)	0.97 – 2.01

The Cobourg DWS Municipal Drinking Water License (MDWL) requires monthly composite samples of backwash wastewater at the point of discharge to Lake Ontario. Table 4 summarizes the results of the sampling program.

Date of MDWL	Parameter	# of Samples	Maximum Annual Average Concentration (mg/L)	Annual Average Concentration (mg/L)
June 23, 2016	Total Suspended Solids	12	25	< 2.5 MDL

In addition to the microbiological sampling and testing requirements, sampling and testing is required for chemical, inorganic and organic parameters. Table 5 illustrates Schedule 13, Schedule 23 and Schedule 24 sample analysis results, with no exceedances during the reporting period. If there were multiple samples taken during the reporting period, the most recent sample result is provided. A parameter below the method detection limit indicated by (<), cannot be detected as the concentration is lower than minimum concentration that can be measured and reported with 99% certainty.



<b>PARAMETER</b>	<b>STANDARD (µg/L)</b>	<b>SAMPLE RESULT (µg/L)</b>	<b>SAMPLE DATE</b>
Benzene	5	0.32 <MDL	07-Jan-19
Carbon tetrachloride	5	0.16 <MDL	
2-Dichlorobenzene	200	0.41 <MDL	
4-Dichlorobenzene	5	0.36 <MDL	
1-Dichloroethylene (vinylidene chloride)	14	0.33 <MDL	
2-Dichloroethane	5	0.35 <MDL	
Dichloromethane	50	0.35 <MDL	
Monochlorobenzene	80	0.3 <MDL	
Tetrachloroethylene (perchloroethylene)	30	0.35 <MDL	
Trichloroethylene	5	0.44 <MDL	
Vinyl Chloride	2	0.17 <MDL	
Diquat	70	1 <MDL	
Paraquat	10	1 <MDL	
Glyphosate	280	1 <MDL	
Polychlorinated Biphenyls (PCBs) - Total	3	0.04 <MDL	
Benzo(a)pyrene	0.01	0.004 <MDL	
Alachlor	5	0.02 <MDL	
Atrazine + N-dealkylated metabolites	5	0.04	
Atrazine	-	0.03	
Desethyl atrazine	-	0.01	
Azinphos-methyl	20	0.05 <MDL	
Carbaryl	90	0.05 <MDL	
Carbofuran	90	0.01 <MDL	
Chlorpyrifos	90	0.02 <MDL	
Diazinon	20	0.02 <MDL	
Dimethoate	20	0.03 <MDL	
Diuron	150	0.03 <MDL	
Malathion	190	0.02 <MDL	
Metolachlor	50	0.01 <MDL	
Metribuzin	80	0.02 <MDL	
Phorate	2	0.01 <MDL	
Prometryne	1	0.03 <MDL	
Simazine	10	0.01 <MDL	
Terbufos	1	0.01 <MDL	
Triallate	230	0.01 <MDL	
Trifluralin	45	0.02 <MDL	
4-dichlorophenoxyacetic acid (24-D)	100	0.19 <MDL	

<b>PARAMETER</b>	<b>STANDARD (µg/L)</b>	<b>SAMPLE RESULT (µg/L)</b>	<b>SAMPLE DATE</b>	
Bromoxynil	5	0.33 <MDL		
Dicamba	120	0.20 <MDL		
Diclofop-methyl	9	0.40 <MDL		
MCPA	-	0.00012 <MDL		
Picloram	190	1 <MDL		
4-dichlorophenol	900	0.15 <MDL		
6-trichlorophenol	5	0.25 <MDL		
6-tetrachlorophenol	100	0.20 <MDL		
Pentachlorophenol	60	0.15 <MDL		
Antimony	6	0.3		
Arsenic	25	0.2 <MDL		
Barium	1000	19.5		
Boron	5000	24		
Cadmium	5	0.003 <MDL		
Chromium	50	0.16		
Mercury	1	0.01 <MDL		
Selenium	10	0.11		
Uranium	20	0.027		
THM: Annual Average	100	25.75		28-Oct-19
HAA: Annual Average	80	5.3 < MDL		
Nitrite	1	< 0.003 MDL		
Nitrate	10	0.327		
Fluoride	1.5	0.06	16-Sept-19	
Sodium	20	12.6		